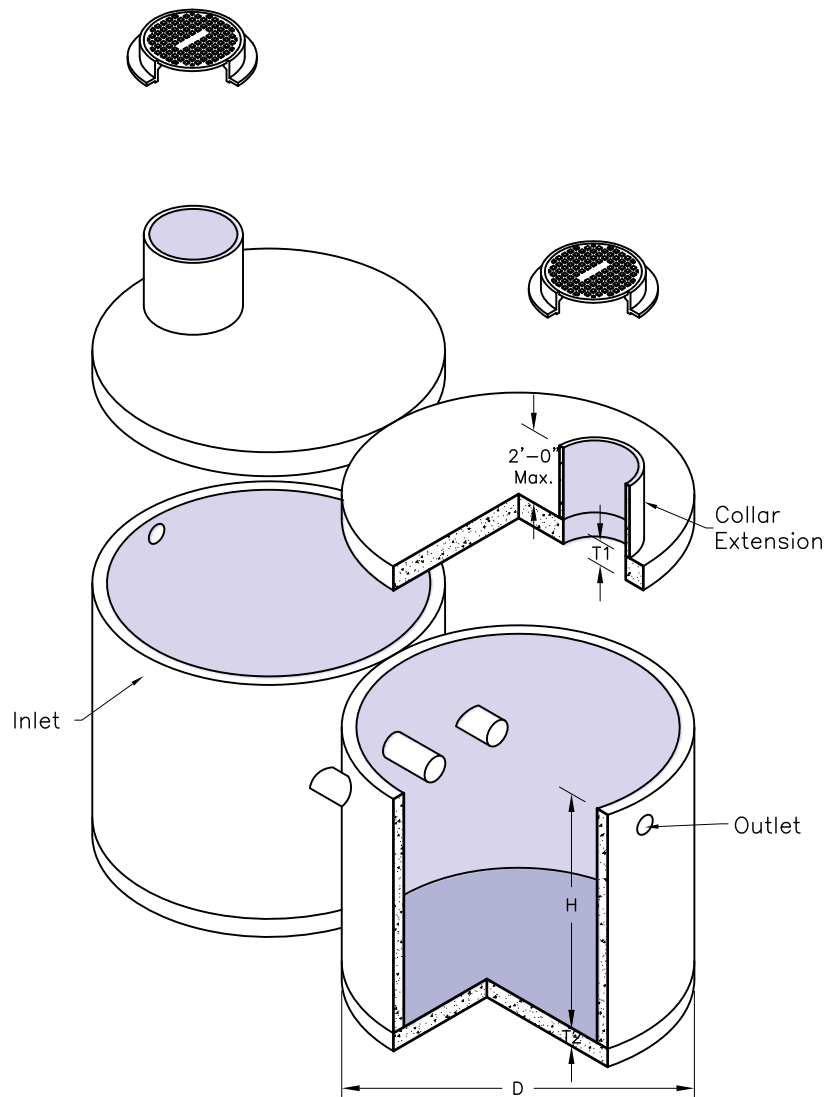


Top Slab
Body


SEPTIC TANK SPECIFICATIONS				
LIQUID CAP/GAL	"D"	"H"	T1	T2
3600	8'-0"	6'-0"	8"	6"
4000	10'-0"	5'-0"	8"	6"
5000	10'-0"	6'-0"	8"	6"
6000	10'-0"	7'-0"	8"	6"
7500	12'-0"	6'-0"	10"	8"
9000	12'-0"	7'-0"	10"	8"
10500	12'-0"	8'-0"	10"	8"

SPECIFICATIONS:

1. Concrete: 28 Day Compressive Strength $f'_c = 4,000$ psi.
2. Steel reinforcement: ASTM A-615, Grade 60, ASTM A-185.
3. Designed for AASHTO HS-20 loading with 24" cover.
4. Piping by others.